





K2 SERIES MANUFACTURERS RECOMMENDED INSTALLATION INSTRUCTIONS FOR SIGNS

WHEN USED W/ K2 CASE


Option 1

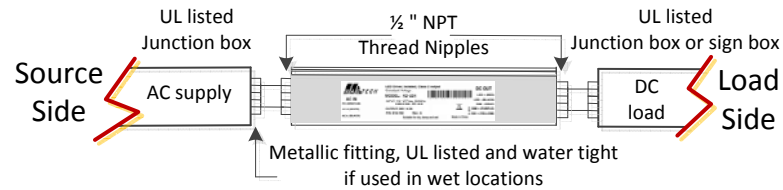

Option 2

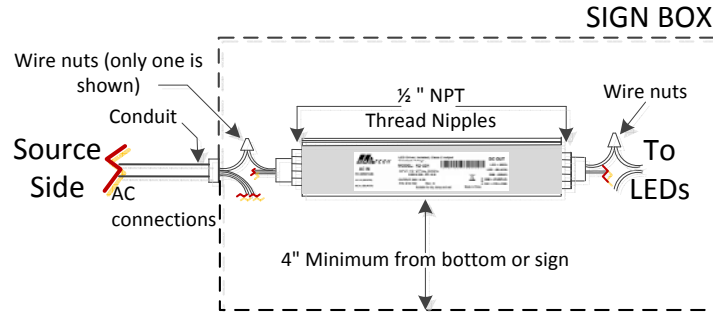


Option 3

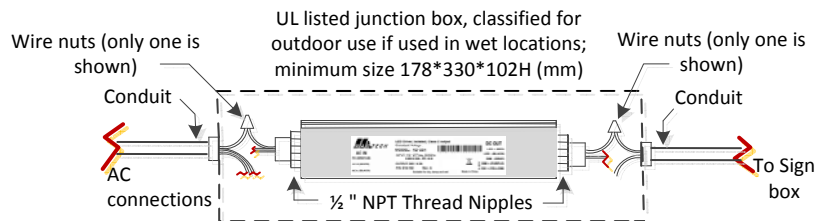


WHEN USED W/ K2-XL CASE


Option 1

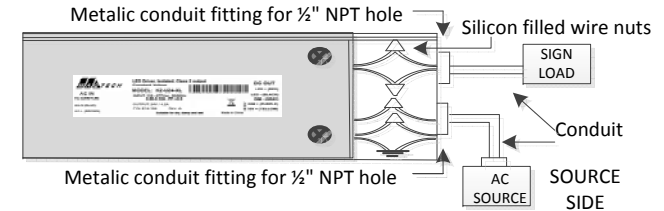

Option 2

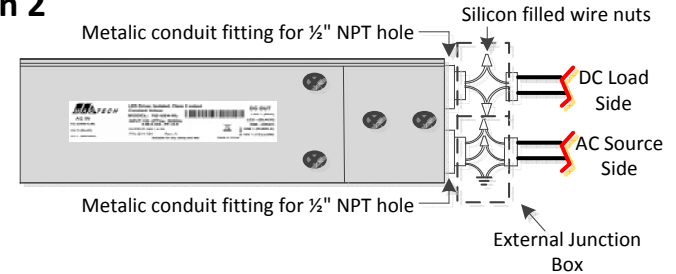

Option 3

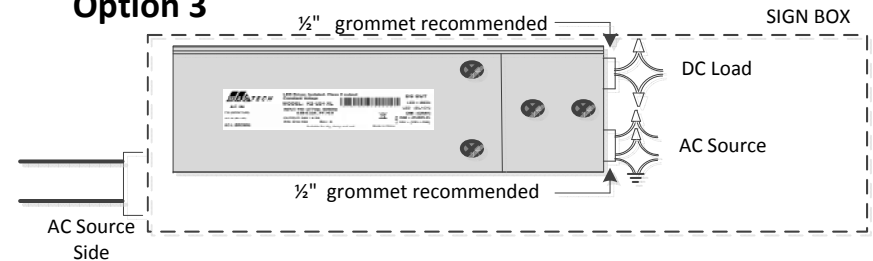

- All models are recognized under UL Standard for Safety for Electric Sign Components, UL 879.
- These power supplies have a single output that complies with Class 2 output requirements.
- The maximum rated output power is 60 watts (12VDC) and 100 Watts (24VDC) output.
- Power supply spacing to other heat producing components shall be minimum of 4 inches when minimum spacing to sidewalls and top of enclosure is kept at 2 inches minimum.
- Power supplies can be used in dry, damp, and wet locations, based on adequate installation practices.

Disclaimer:

- All of the above installation methods are recommended by the manufacturer.
- All of the above installation shall follow and comply with all local NEC regulations.
- Manufacturer reserves the right to make changes without prior notifications to the customers.