PP Series Power Packs





Power switch packs provide both the 24 V power supply to operate Lutron sensors as well as the 20 A line voltage relay to control the load in one compact housing. The unit can be placed outside or inside the junction box with a simple twist-on nut. The auxiliary relay model can be used with line voltage power packs to switch additional loads.


Features

- High-impact UL94 5 VA flammability-rated plastic case construction.
- Relay: Class B (130°C) insulating material; silver alloy contacts.
- 120 V, 277 V, or 347 V \tansformer: 60 Hz; 230 V transformer: 50 Hz.
- 24 V= nominal output; 100 mA nominal, full wave rectified and filtered.
- 7" wire leads, 18 AWG input; 7" leads, 16 AWG contacts.
- Relay contact rating:
 - --20 A: 120/230/277 V ballast 5 amps is the maximum per Lutron, for
 - --15 A: 347 V ballast LED loads!
 - --15 A: 120 V incandescent
- Complies with requirements for use in a compartment handling conditioned air (plenum).
- Supports up to 3 devices, including occupant sensors and PP-SH units.
- Operating environment: 32°F to 104°F (0°C to 40°C); less than 90% relative humidity, non-condensing.
- For indoor use only.

Model Numbers

| Catalog Number | Power Input | Control Input | Power Output |
|----------------|---------------------|---------------------|-----------------------|
| PP-120H | 120 V∕v, 60 Hz | 24 V , 5 mA | 24 V , 100 mA |
| PP-230H | 230 V∕v, 50 & 60 Hz | 24 V , 5 mA | 24 V, 100 mA |
| PP-277H | 277 V∕v, 60 Hz | 24 V , 5 mA | 24 V, 100 mA |
| PP-347H | 347 V∕, 60 Hz | 24 V , 5 mA | 24 V , 100 mA |
| PP-SH | N/A | 24 V , 5 mA | N/A |

Dimensions

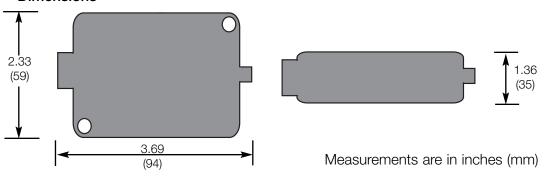

LUTRON SPECIFICATION SUBMITTAL


Page

| Job Name: | Model Numbers: | |
|-------------|----------------|--|
| | | |
| Job Number: | | |


PP-2 06.09.05

Wiring

1 to 3 Sensors with Power Pack

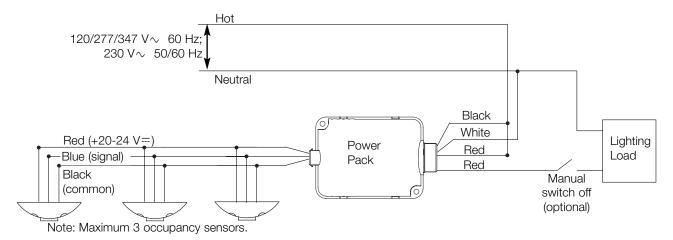

Switching Multiple Loads with Auxiliary Power Packs

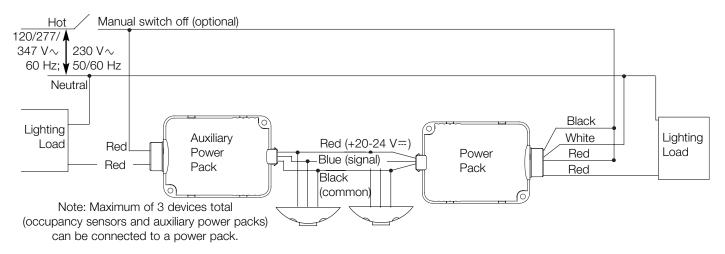

LUTRON SPECIFICATION SUBMITTAL


Page


| Job Name: | Model Numbers: |
|-------------|----------------|
| | |
| Job Number: | |

PP-3 06.09.05

Mounting







Fits inside junction box or standard fluorescent fixture ballast cavity

Mount with 6/32 x 1.25" pan head screws

Mounts to standard 4" x 4" junction box through knockout with 1/2" EMT threaded nipple.

Note: Always turn power off and lock out during unit installation.

Always install unit in accordance with applicable national and local electrical codes.

Installation

- Wire according to appropriate Wiring Diagram.
- Warning: Risk of electrical shock from energized equipment.
 Always turn power OFF and lock out during unit installation.
 Always install units in accordance with applicable national and local electrical codes.

| 3 ¹¹ / ₂ | ITRON. | SPECIFIC | NOITA: | SUBMITTAL |
|--------------------------------|--------|----------|--------|-----------|
| | | | | |

| Job Name: | Model Numbers: | |
|-------------|----------------|--|
| | | |
| Job Number: | | |

Page